


保定曲阳路庄子110kV输变电工程勘测定界图

4275.12-38558.16

图幅号: J50 H 067022

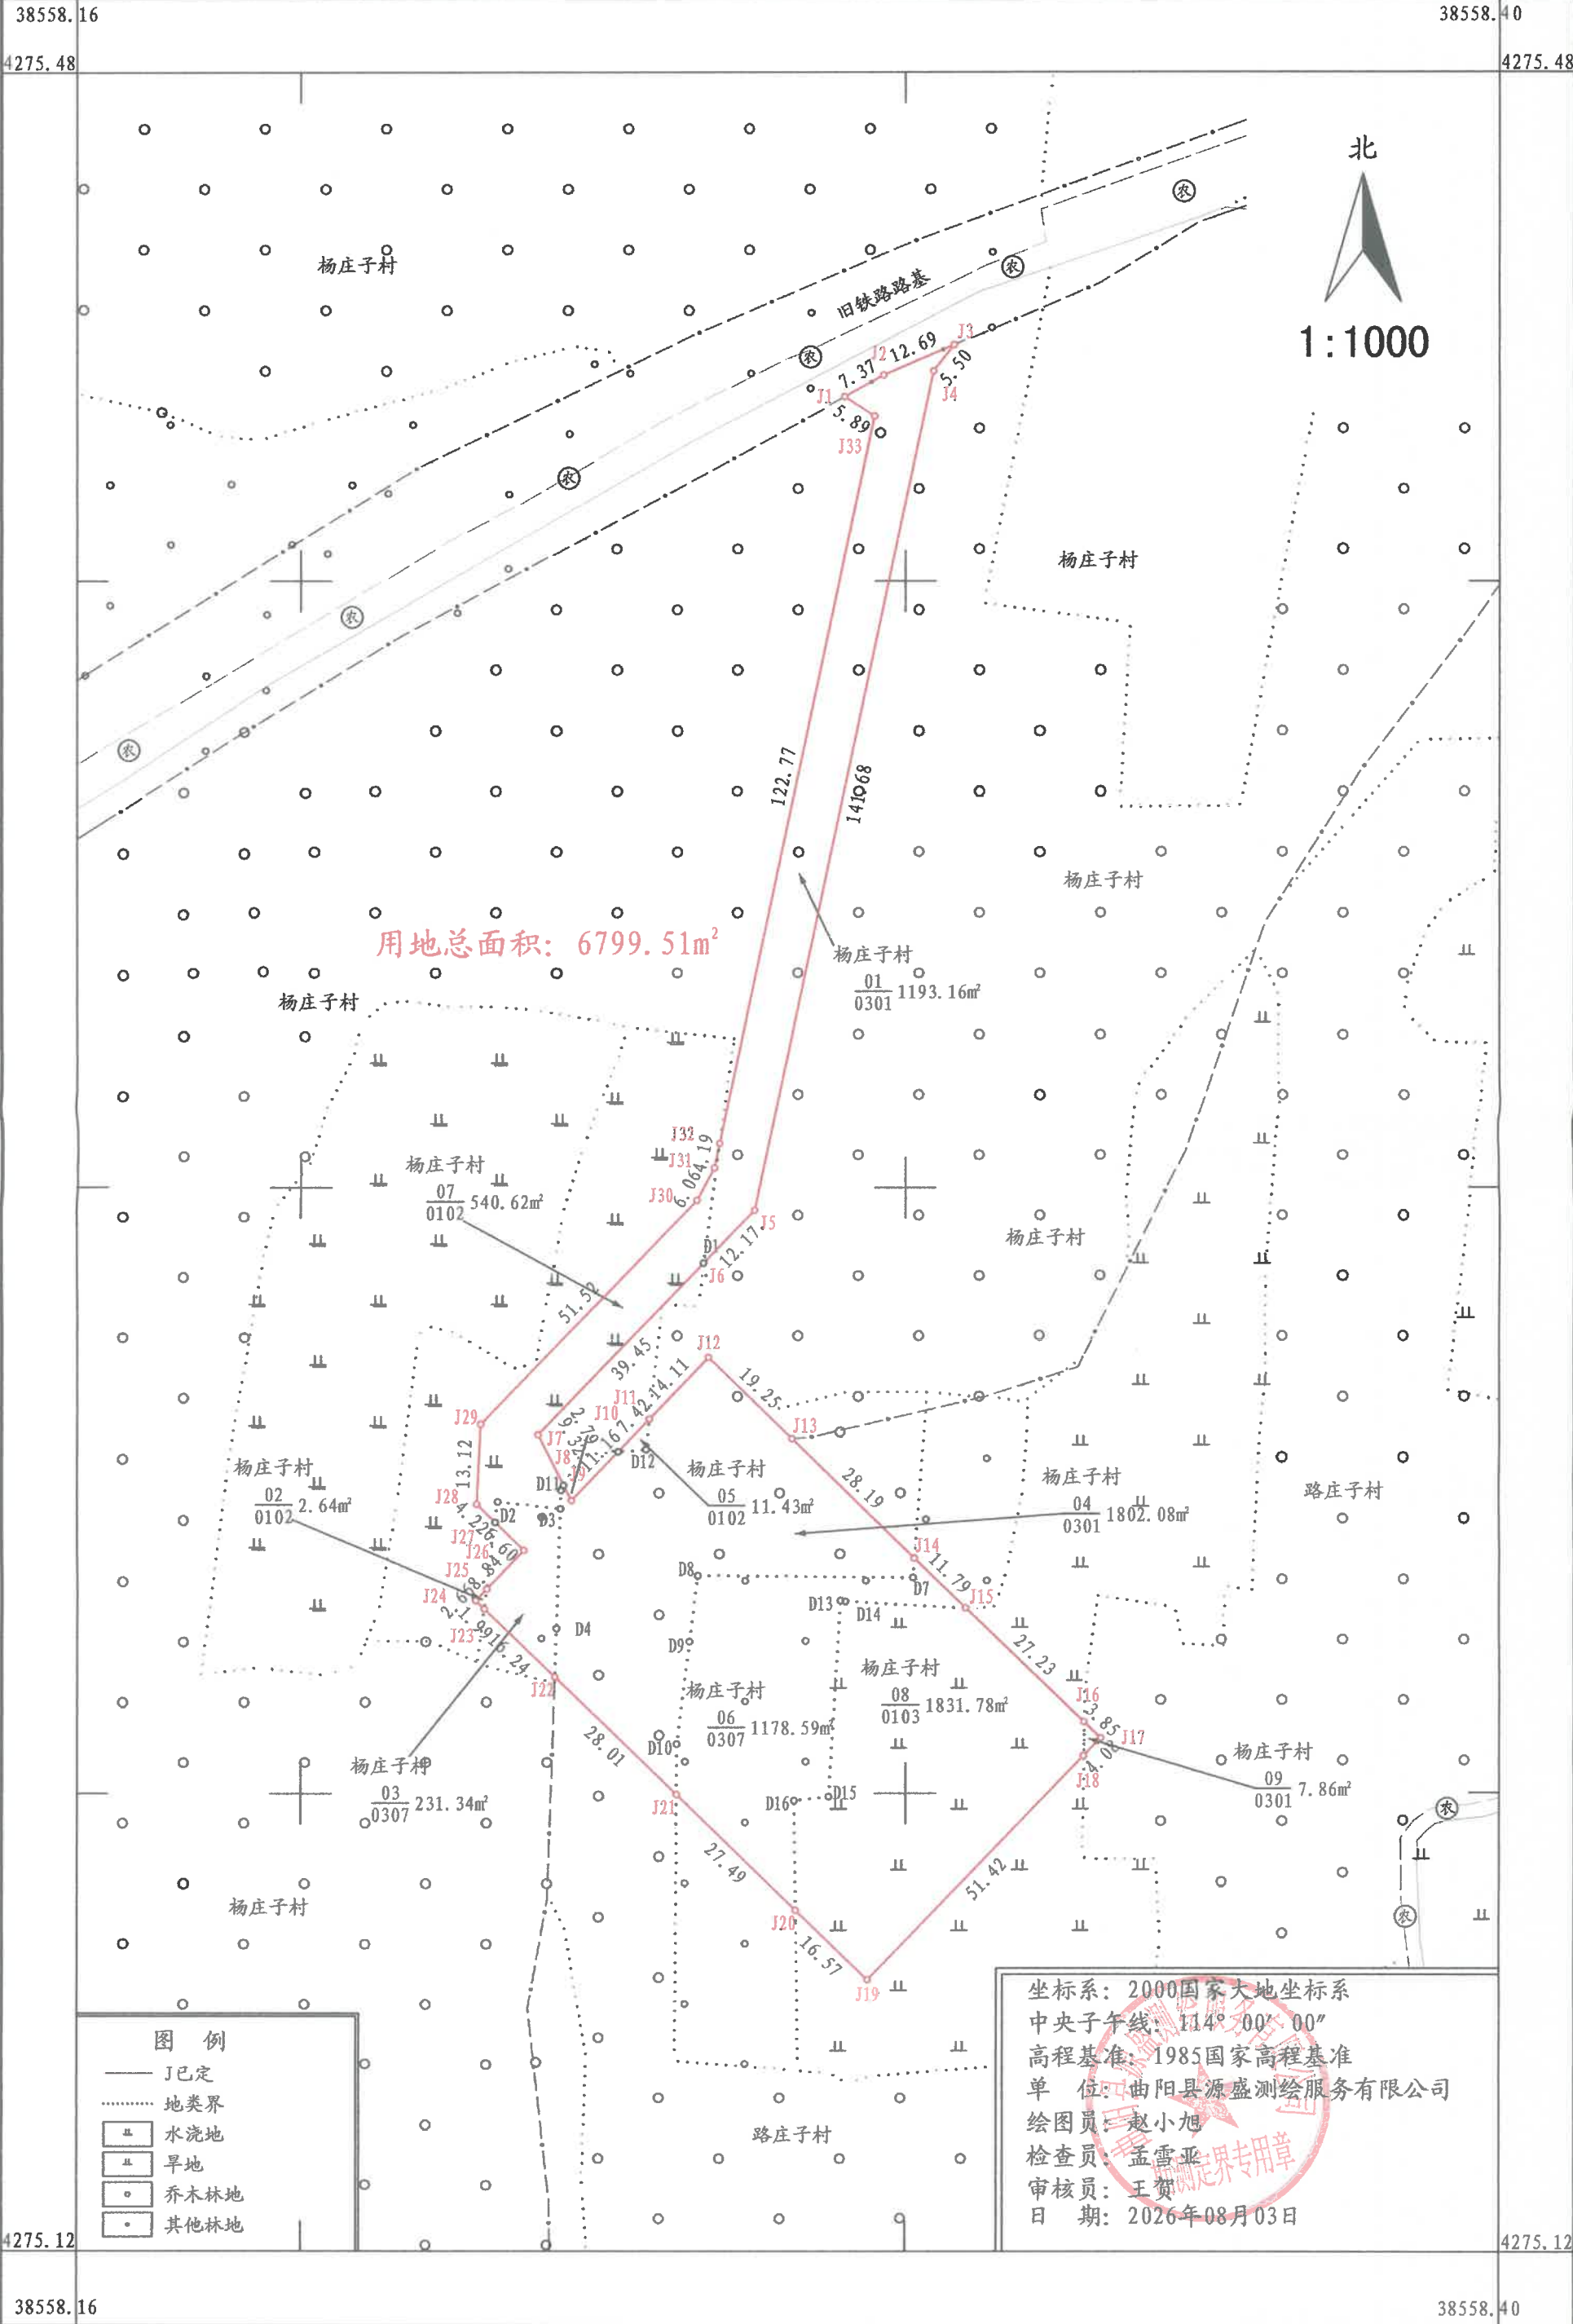

△X=0, △Y=0